


ANNUAL WATER QUALITY REPORT

Reporting Year 2025



Presented By

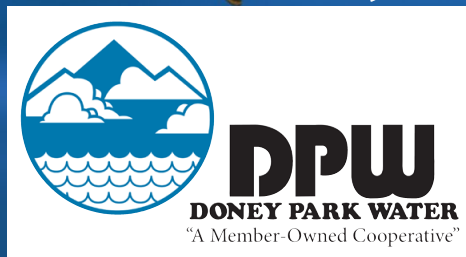

PWS ID#: 03005

Este informe contiene información muy importante sobre su agua potable. Tradúzcalo o hable con alguien que lo entienda bien.



Our Commitment

We are pleased to present to you this year's annual water quality report. This report is a snapshot of last year's water quality covering all testing performed between January 1 and December 31, 2025. Included are details about your source of water, what it contains, and how it compares to standards set by regulatory agencies. Our constant goal is to provide you with a safe and dependable supply of drinking water. We want you to understand the efforts we make to continually improve the water treatment process and protect our water resources. We are committed to ensuring the quality of your water and providing you with this information because informed customers are our best allies.

Where Does My Water Come From?

In 2025, Doney Park Water produced approximately 244 million gallons of water at an average of 670,212 gallons per day. Our water source is six deep groundwater wells in the Coconino Aquifer, which ranges from 1,260 to 1,500 feet below Doney Park.

Source Water Assessment

Based on the information currently available on the hydrogeological settings of the adjacent land in the specified proximity of the drinking water sources of this public water system, the Arizona Department of Environmental Quality has given a low risk designation for the degree to which this public water system's drinking water sources are protected. A low risk designation indicates that either most source water protection measures are already implemented or the hydrogeology is such that the source water protection measures will have little impact on protection. The Assessment results can be viewed at Doney Park Water Office, 5290 E. Northgate Loop Flagstaff AZ, 86004

Think Before You Flush!

Flushing unused or expired medicines can be harmful to your drinking water. Properly disposing of unused or expired medication helps protect you and the environment. Keep medications out of our waterways by disposing responsibly. To find a convenient drop-off location near you, please visit bit.ly/3leRyXy.

Water Conservation Tips

You can play a role in conserving water and saving yourself money in the process by becoming conscious of the amount of water your household is using and by looking for ways to use less whenever you can. It is not hard to conserve water. Here are a few tips:


- Automatic dishwashers use 15 gallons for every cycle, regardless of how many dishes are loaded. So get a run for your money and load it to capacity.
- Turn off the tap when brushing your teeth.
- Check every faucet in your home for leaks. Just a slow drip can waste 15 to 20 gallons a day. Fix it and you can save almost 6,000 gallons per year.
- Check your toilets for leaks by putting a few drops of food coloring in the tank. Watch for a few minutes to see if the color shows up in the bowl. It is not uncommon to lose up to 100 gallons a day from an invisible toilet leak. Fix it and you save more than 30,000 gallons a year.
- Use your water meter to detect hidden leaks. Simply turn off all taps and water using appliances. Then check the meter after 15 minutes. If it moved, you have a leak.



Important Health Information

Some people may be more vulnerable to contaminants in drinking water than the general population. Immunocompromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health-care providers.

U.S. Environmental Protection Agency (U.S. EPA)/Centers for Disease Control and Prevention (CDC) guidelines on appropriate means to lessen the risk of infection by Cryptosporidium and other microbial contaminants are available from the Safe Drinking Water Hotline (800-426-4791) or epa.gov/safewater.

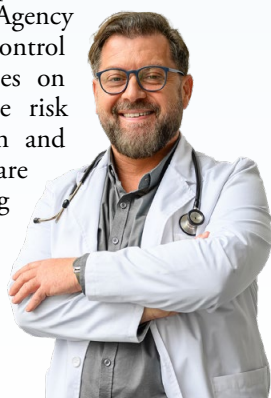


QUESTIONS?

For more information about this report, or for any questions relating to your drinking water, please call Marc Twidwell, General Manager, at (928) 526-1080.

Substances That Could Be in Water

To ensure that tap water is safe to drink, the Arizona Department of Environmental Quality prescribes regulations limiting the amount of certain contaminants in water provided by public water systems. U.S. Food and Drug Administration regulations establish limits for contaminants in bottled water. Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of these contaminants does not necessarily indicate that the water poses a health risk.



The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals, in some cases radioactive material, and substances resulting from the presence of animals or from human activity. Contaminants that may be present in source water include:

Microbial Contaminants, such as viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations, or wildlife;

Inorganic Contaminants, such as salts and metals, which can be naturally occurring or may result from urban stormwater runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming;

Pesticides and Herbicides, which may come from a variety of sources such as agriculture, urban stormwater runoff, and residential uses;

Organic Chemical Contaminants, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production and may also come from gas stations, urban stormwater runoff, and septic systems; and

Radioactive Contaminants, which can be naturally occurring or the result of oil and gas production and mining activities.

More information about contaminants in tap water and potential health effects can be obtained by calling the Safe Drinking Water Hotline at (800) 426-4791 or visiting epa.gov/safewater. Information on bottled water can be obtained from the U.S. Food and Drug Administration.

Additional Information

In 2025, the U.S. EPA tested for per- and polyfluoroalkyl substances (PFAS) using method EPA 537.1. All results were below the detection limit.

Lead in Home Plumbing

Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. We are responsible for providing high-quality drinking water, but we cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead and wish to have your water tested, contact Marc Twidwell, General Manager, at (928) 526-1080. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available at epa.gov/safewater/lead.


To address lead in drinking water, public water systems were required to develop and maintain an inventory of service line materials by October 16, 2024. Developing an inventory and identifying the location of lead service lines (LSL) is the first step for beginning LSL replacement and protecting public health. Please contact us at Info@doneyparkwater.com if you would like more information about the inventory or any lead sampling that has been done.

Level 1/2 Assessment Update

Coliforms are bacteria that are naturally present in the environment and used as an indicator that other, potentially harmful, waterborne pathogens may be present or that a potential pathway exists through which contamination may enter the drinking water distribution system. We found coliforms, indicating the need to look for potential problems in water treatment or distribution. When this occurs, we are required to conduct assessments to identify problems and correct any problems that were found during these assessments.

During the past year, we were required to conduct one Level 1 assessment. One Level 1 assessment was completed. We were not required to take any corrective actions.

During the past year, we were required to complete one Level 2 assessment for our water system. One Level 2 assessment was completed. We were not required to take any corrective actions.

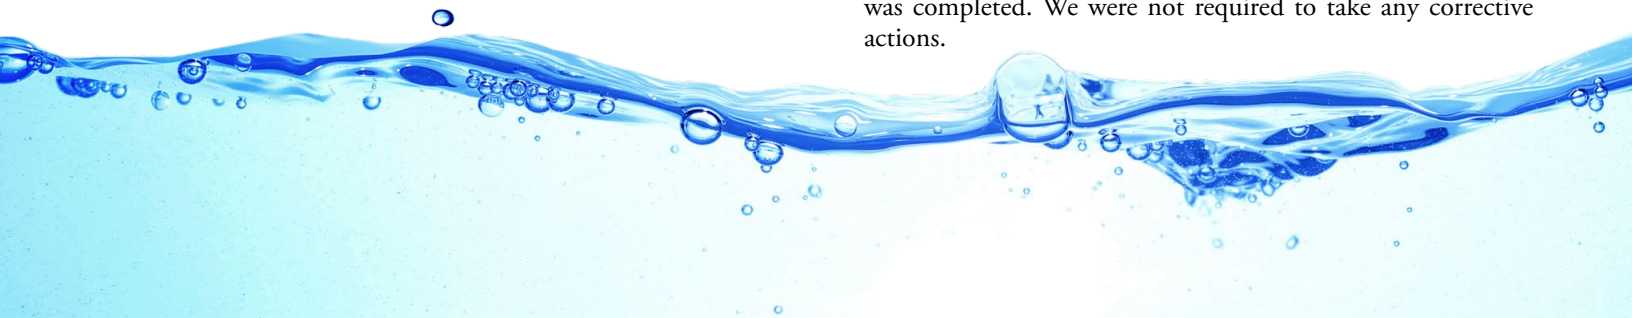

BY THE NUMBERS



82

The average number of gallons of water an American uses per day.



27%

The percent of household water use attributable to toilets.



700

The average number of gallons that a household can save each year with water-efficient fixtures.



50-100

The typical design lifespan of underground drinking water pipes, in years.



<1%

The percent of Earth's water that is readily available as fresh drinking water.

Q&A

Why can tap water have a taste?

Taste in drinking water is usually related to naturally occurring minerals, disinfectants, or seasonal changes in source water. While these characteristics may affect taste, they do not typically indicate a health risk.



Why is water sometimes called the “original energy drink”?

Water helps regulate body temperature, supports digestion, and keeps joints moving—without sugar, calories, or caffeine.

Can weather affect drinking water quality?

Heavy rain, drought, or seasonal changes can influence source water conditions. Water systems adjust treatment processes as needed to maintain water quality during changing environmental conditions.

Why is maintaining water infrastructure important?

Pipes, pumps, and treatment facilities are critical for delivering safe drinking water. Regular maintenance and upgrades help prevent leaks, breaks, and service disruptions.

What can customers do to help protect water quality?

Customers can help by reporting leaks, avoiding cross-connections, maintaining household plumbing, and staying informed through their annual water quality report.

Community Participation

We want our valued customers to be informed about their water quality. If you have questions or concerns, feel free to call a customer service representative or attend a board meeting on the third Wednesday of each month at 9:00 a.m. at our office. Board meeting dates can be found at DoneyParkWater.com. Customer service can be reached at (928) 526-1080.

Non-Detected Contaminants

All contaminants listed below were tested for and were NOT found in our water. These contaminants are considered Non-Detect or not present:

Synthetic Organic Compounds: 2,4-D, 2,4,5-TP (a.k.a. Silvex), Acrylamide, Alachlor, Atrazine, Benzo (a) pyrene (PAH), Carbofuran, Chlordane, Dalapon, Di (2-ethylhexyl) adipate, Di (2-ethylhexyl) phthalate, Dibromochloropropane, Dinoseb, Diquat, Dioxin [a.k.a. 2,3,7,8-TCDD], Endothall, Endrin, Epichlorohydrin, Ethylene dibromide, Glyphosate, Heptachlor, Heptachlor epoxide, Hexachlorobenzene, Hexachlorocyclo pentadiene, Lindane, Methoxychlor, Oxamyl (a.k.a. Vydate), PCBs (Polychlorinated biphenyls), Pentachlorophenol, Picloram, Simazine, Toxaphene

Volatile Organic Compounds: Benzene, Carbon tetrachloride, Chlorobenzene, o-Dichlorobenzene, p-Dichlorobenzene, 1,2-Dichloroethane, 1,1-Dichloroethylene, cis-1,2 Dichloroethylene, trans-1,2-Dichloroethylene, Dichloromethane, 1,2-Dichloropropane, Ethylbenzene, Styrene, Tetrachloroethylene, 1,2,4-Trichlorobenzene, 1,1,1-Trichloroethane, 1,1,2-Trichloroethane, Trichloroethylene, Toluene, Vinyl Chloride, Xylenes

Inorganic Chemicals (Last tested DATE): Antimony, Arsenic, Asbestos, Barium, Beryllium, Cadmium, Chromium, Cyanide, Fluoride, Mercury, Nitrite, Selenium, Thallium

Should I be Concerned About What I'm Pouring Down my Drain?

If your home is served by a sewage system, your drain is an entrance to your wastewater disposal system and eventually to a drinking water source. Consider purchasing environmentally friendly home products whenever possible, and never pour hazardous materials (e.g., car engine oil) down the drain. Check with your health department for more information on proper disposal methods.

Test Results

Our water is monitored for many different kinds of substances on a very strict sampling schedule, and the water we deliver must meet specific health standards. Here, we only show those substances that were detected in our water (a complete list of all our analytical results is available upon request). Remember that detecting a substance does not mean the water is unsafe to drink; our goal is to keep all detects below their respective maximum allowed levels.

The state recommends monitoring for certain substances less than once per year because the concentrations of these substances do not change frequently. In these cases, the most recent sample data is included, along with the year in which the sample was taken.

We participated in the fifth stage of the U.S. EPA's Unregulated Contaminant Monitoring Rule (UCMR5) program by performing additional tests on our drinking water. UCMR5 sampling benefits the environment and public health by providing the U.S. EPA with data on the occurrence of contaminants suspected to be in drinking water to determine if it needs to introduce new regulatory standards to improve drinking water quality. Unregulated contaminant monitoring data is available to the public, so please feel free to contact us if you are interested in obtaining that information. If you would like more information on the U.S. EPA's Unregulated Contaminant Monitoring Rule, please call the Safe Drinking Water Hotline at (800) 426-4791.

REGULATED SUBSTANCES

SUBSTANCE (UNIT OF MEASURE)	YEAR SAMPLED	MCL [MRDL]	MCLG [MRDLG]	AMOUNT DETECTED	RANGE LOW-HIGH	VIOLATION	TYPICAL SOURCE
Alpha Emitters (pCi/L)	2021	15	0	3.6 +/-0.79	ND-3.6 +/-0.79	No	Erosion of natural deposits
Arsenic (ppb)	2024	10	0	1.2	ND-1.2	No	Erosion of natural deposits; Runoff from orchards; Runoff from glass and electronics production wastes
Barium (ppm)	2024	2	2	1.7	1-1.7	No	Discharge of drilling wastes; Discharge from metal refineries; Erosion of natural deposits
Chromium (ppb)	2024	100	100	2.2	NA	No	Discharge from steel and pulp mills; Erosion of natural deposits
Fluoride (ppm)	2024	4	4	0.090	0.088-0.090	No	Erosion of natural deposits; Water additive which promotes strong teeth; Discharge from fertilizer and aluminum factories
Nitrate (ppm)	2025	10	10	3.3	ND-3.3	No	Runoff from fertilizer use; Leaching from septic tanks, sewage; Erosion of natural deposits

Tap water samples were collected for lead and copper analyses from sample sites throughout the community

SUBSTANCE (UNIT OF MEASURE)	YEAR SAMPLED	AL	MCLG	AMOUNT DETECTED (90TH %ILE)	RANGE LOW-HIGH	SITES ABOVE AL/TOTAL SITES	VIOLATION	TYPICAL SOURCE
Copper (ppm)	2024	1.3	1.3	0.12	0.023-0.16	0/20	No	Corrosion of household plumbing systems; Erosion of natural deposits
Lead (ppb)	2024	15	0	ND	NA	0/20	No	Lead service lines; Corrosion of household plumbing systems, including fittings and fixtures; Erosion of natural deposits

UNREGULATED SUBSTANCES

SUBSTANCE (UNIT OF MEASURE)	YEAR SAMPLED	AMOUNT DETECTED	RANGE LOW-HIGH	TYPICAL SOURCE
Sodium (ppm)	04/17/2024	17	6.0-17	Erosion of natural deposits

Definitions

90th %ile: The levels reported for lead and copper represent the 90th percentile of the total number of sites tested. The 90th percentile is equal to or greater than 90% of our lead and copper detections.

AL (Action level): The concentration of a contaminant that, if exceeded, triggers treatment or other requirements that a community water system shall follow.

Herbicide: Any chemical(s) used to control undesirable vegetation.

Level 1 Assessment: A Level 1 assessment is a study of the water system to identify potential problems and determine (if possible) why total coliform bacteria have been found in our water system.

Level 2 Assessment: A Level 2 assessment is a very detailed study of the water system to identify potential problems and determine (if possible) why an *E. coli* MCL violation has occurred and/or why total coliform bacteria have been found in our water system on multiple occasions.

MCL (Maximum Contaminant Level): The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

MCLG (Maximum Contaminant Level Goal): The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

MRDL (Maximum Residual Disinfectant Level): The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

MRDLG (Maximum Residual Disinfectant Level Goal): The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

NA: Not applicable.

ND (Not detected): Indicates that the substance was not found by laboratory analysis.

pCi/L (picocuries per liter): A measure of radioactivity.

Pesticide: Generally, any substance or mixture of substances intended for preventing, destroying, repelling, or mitigating any pest.

ppb (parts per billion): One part substance per billion parts water (or micrograms per liter).

ppm (parts per million): One part substance per million parts water (or milligrams per liter).